17 Harrison Street
Marshalltown

P O Box 61542
Marshalltown 2107
Tel : (011) 688-1400 Fax : (011) 688-1556

Johannesburg Water

PAGE NO.	
CLOSING DATE AND TIME	
6-Dec-19	16:00
Date of Issue	
28 November 2019	
VALIDITY	
60 DAYS	

INITIATING DEPARTMENT	INITIATOR
OPERATIONS-BULK WASTE WATER	Lesego Motsepe
QUOTATION REFERENCE	COLLECTIVE NO.
	JWRFQPM838
QUOTATION REQUESTED FROM	
OLIFANTSVLEI WORKS	

JWRFQPM838 - DIAL THERMOMETER TEMPERATURE GAUGES

REQUEST FOR QUOTATION

QUOTATION DATE

QUOTATIONS WILL BE EVALUATED ON THE 80/20 POINT SCORING SYSTEM.80 POINTS WILL BE ALLOCATED TO PRICE AND THE REMAINING 20 POINTS WILL BE ALLOCATED FOR BBBEE AND PREFERENTIAL PROCUREMENT
ALL SUPPLIERS RESPONDING TO QUOTATIONS SHOULD BE REGISTERED ON CENTRAL SUPPLIER DATABASE(CSD)

JW CONTACT PERSON: Paul Mabatane Mangoale

TEL: (011) 688 1408 Fax (0110 688 1556 Email: paul.mangoale@jwater.co.za

ITEM NO.	DESCRIPTION	DESCRIPTION OF ITEM OFFERED	UOM	QTY REQUIRED	PRICE QUOTED EXCL. OF V.A.T.	DIS
1	SUPPLY AND DELIVERY OF **DIAL THERMOMETER TEMPERATURE**			5		
	GAUGES FITTED WITH 316 STAINLESS STEEL PROBE WITH A T-PIECE.					
	TEMPERATURE GAUGE SPECIFICATION:					
	100mm Dial Size With a Range From 0 - 100 deg Celsius					
	Bottom entry with 1/2"BSP Stainless Steel Hex fitting					
	Glycerine Filled					
	316 STAINLESS STEEL PROBE SPECIFUICATION:					
	1000mm Long with 10mm OD					
	T-Piece 300mm Long, Welded to Hex 150mm on Either Side					

OFFICIAL STAMP	SUPPLIER DETAILS
	AUTHORISED BY: ..... SIGNATURE:..... DATE:.....

CONDITIONS
1. QUOTATIONS RECEIVED AFTER CLOSE OF BUSINESS ON THE CLOSING DATE WILL NOT BE ACCEPTED.
2. QUOTATIONS WITHOUT BRAND NAMES WHERE REQUIRED WILL NOT BE ACCEPTED
3. PRICES QUOTED MUST BE AS PER THE UNIT INDICATED AND BE EXCLUDED OF VAT
4 QUOTATIONS WITHOUT THE SUPPLIER'S AUTHORISED SIGNATURE WILL NOT BE ACCEPTED.
5 ACCEPTANCE OF A QUOTATION WILL BE SUBJECT TO JOHANNESBURG WATER'S SUPPLY CHAIN POLICY

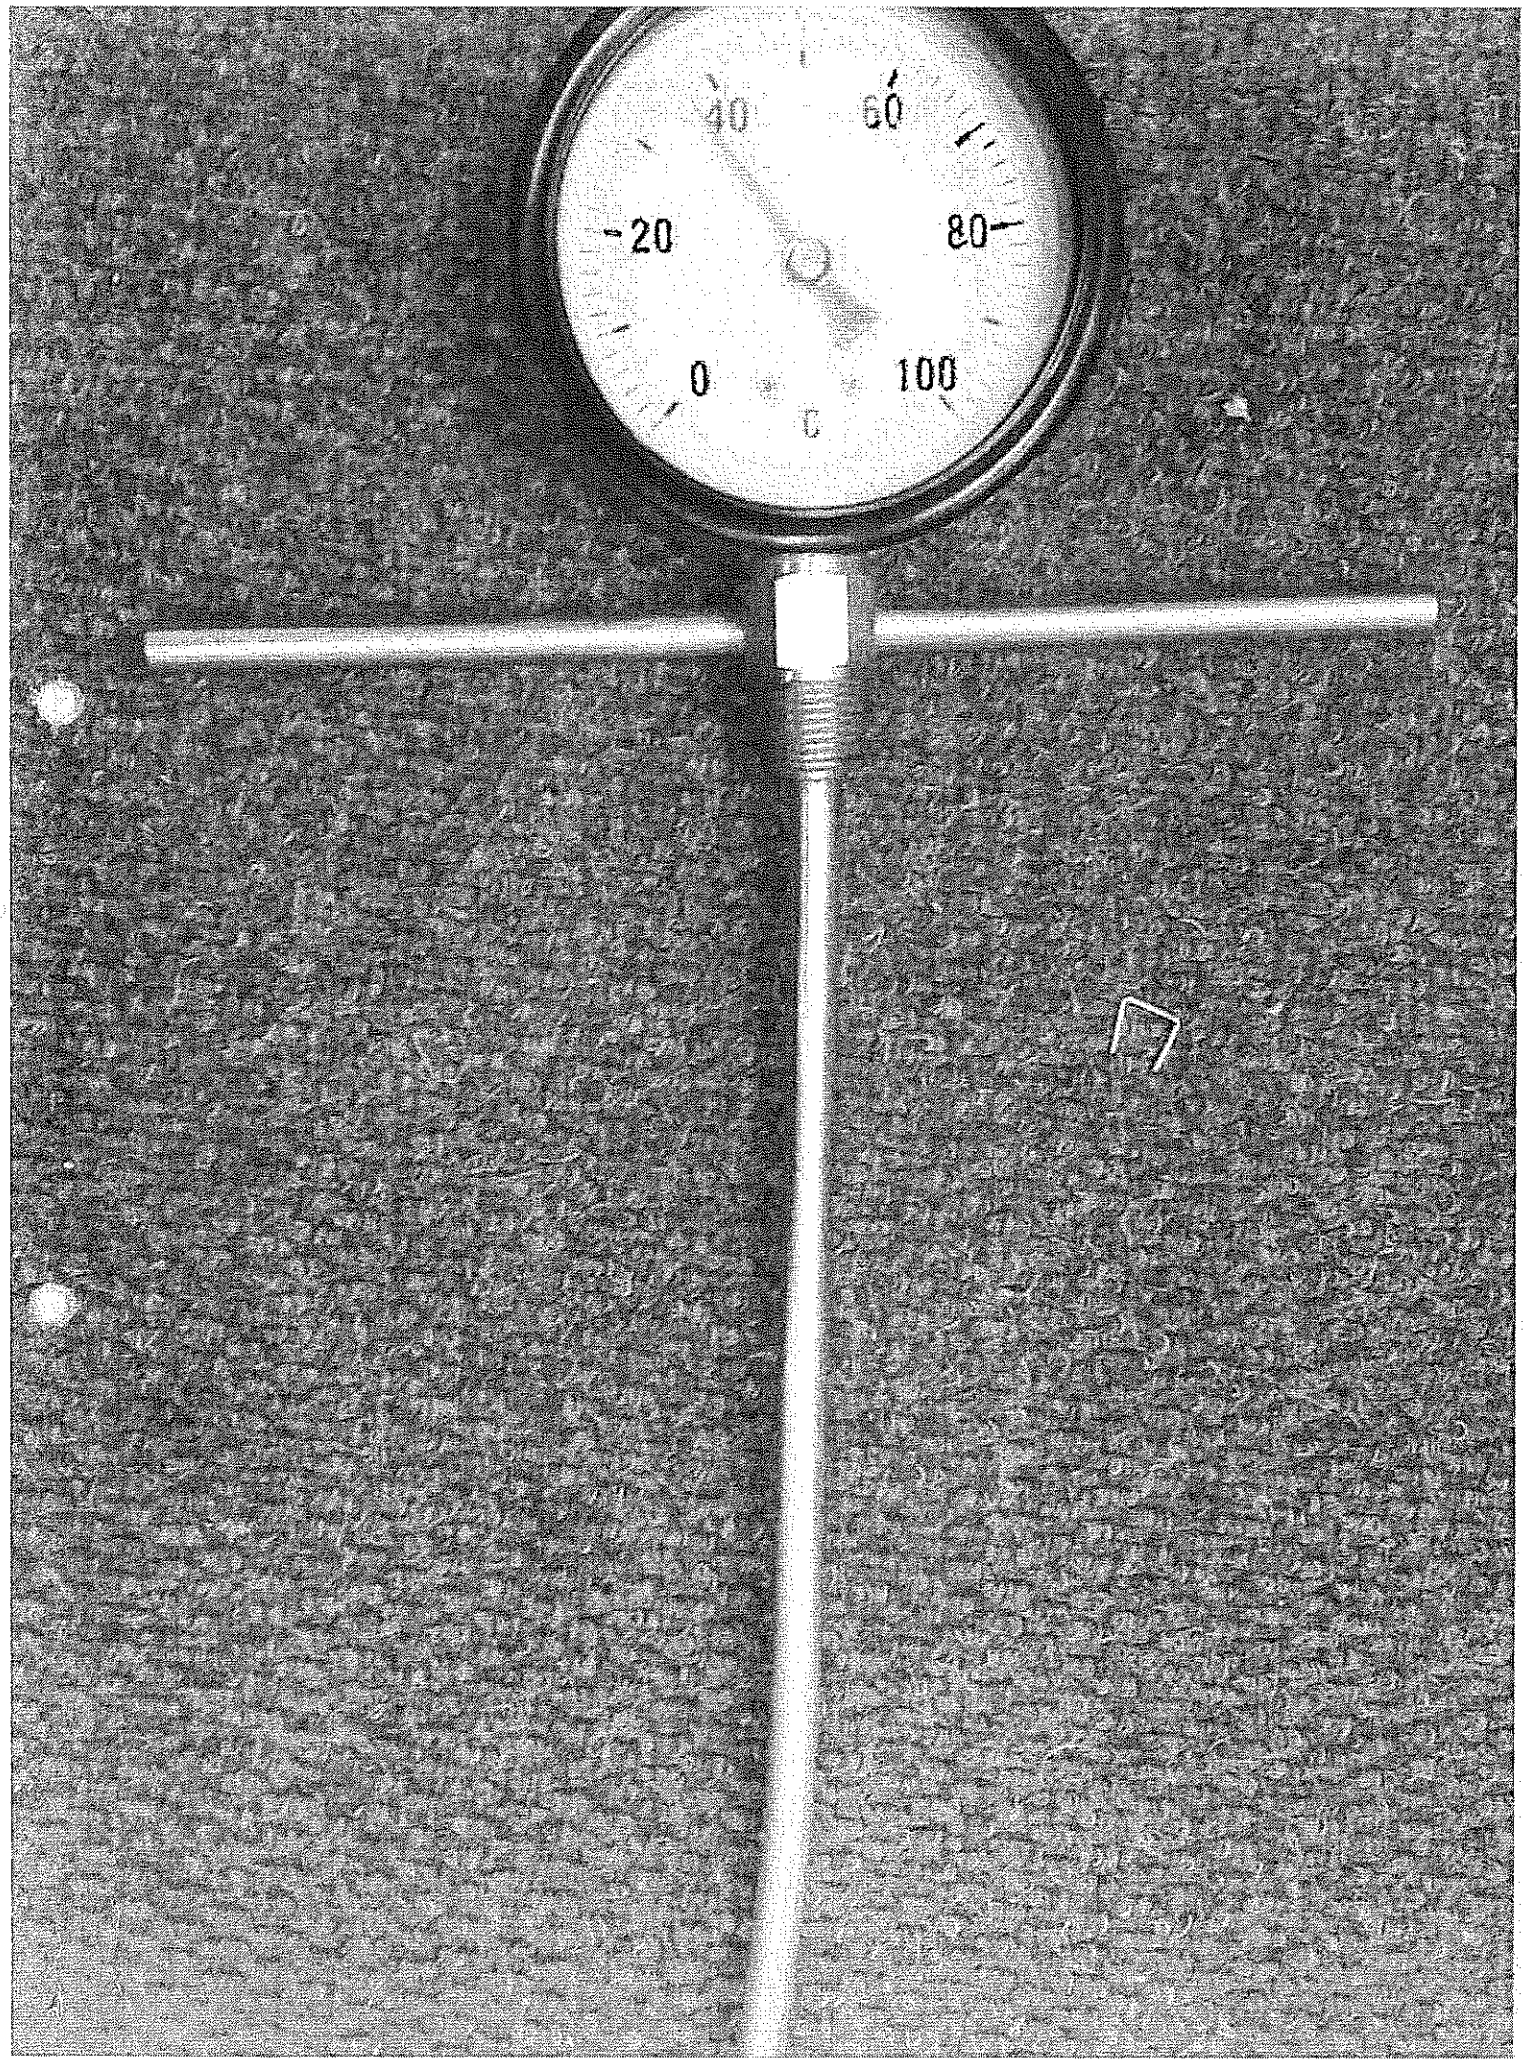
40
60
20
80
0
100
C